


NOTE :

CURB BOX SHALL BE LOCATED IMMEDIATELY BEHIND CURB OR SIDEWALK
 METER PIT SHALL BE PLACED ADJACENT TO DISCHARGE SIDE OF CURB BOX.

METER PIT DEPTH IS APPROXIMATELY 7' WITH LID. MAKE DEPTH ADJUSTMENTS ON
 SERVICE LINES OUTSIDE PIT BY RAISING OR LOWERING SERVICE LINE.

DO NOT CUT METER PIT TO MATCH DEPTH OF SERVICE LINE.

NOTE: CHANGED TEXT SIZES TO MATCH EACH OTHER

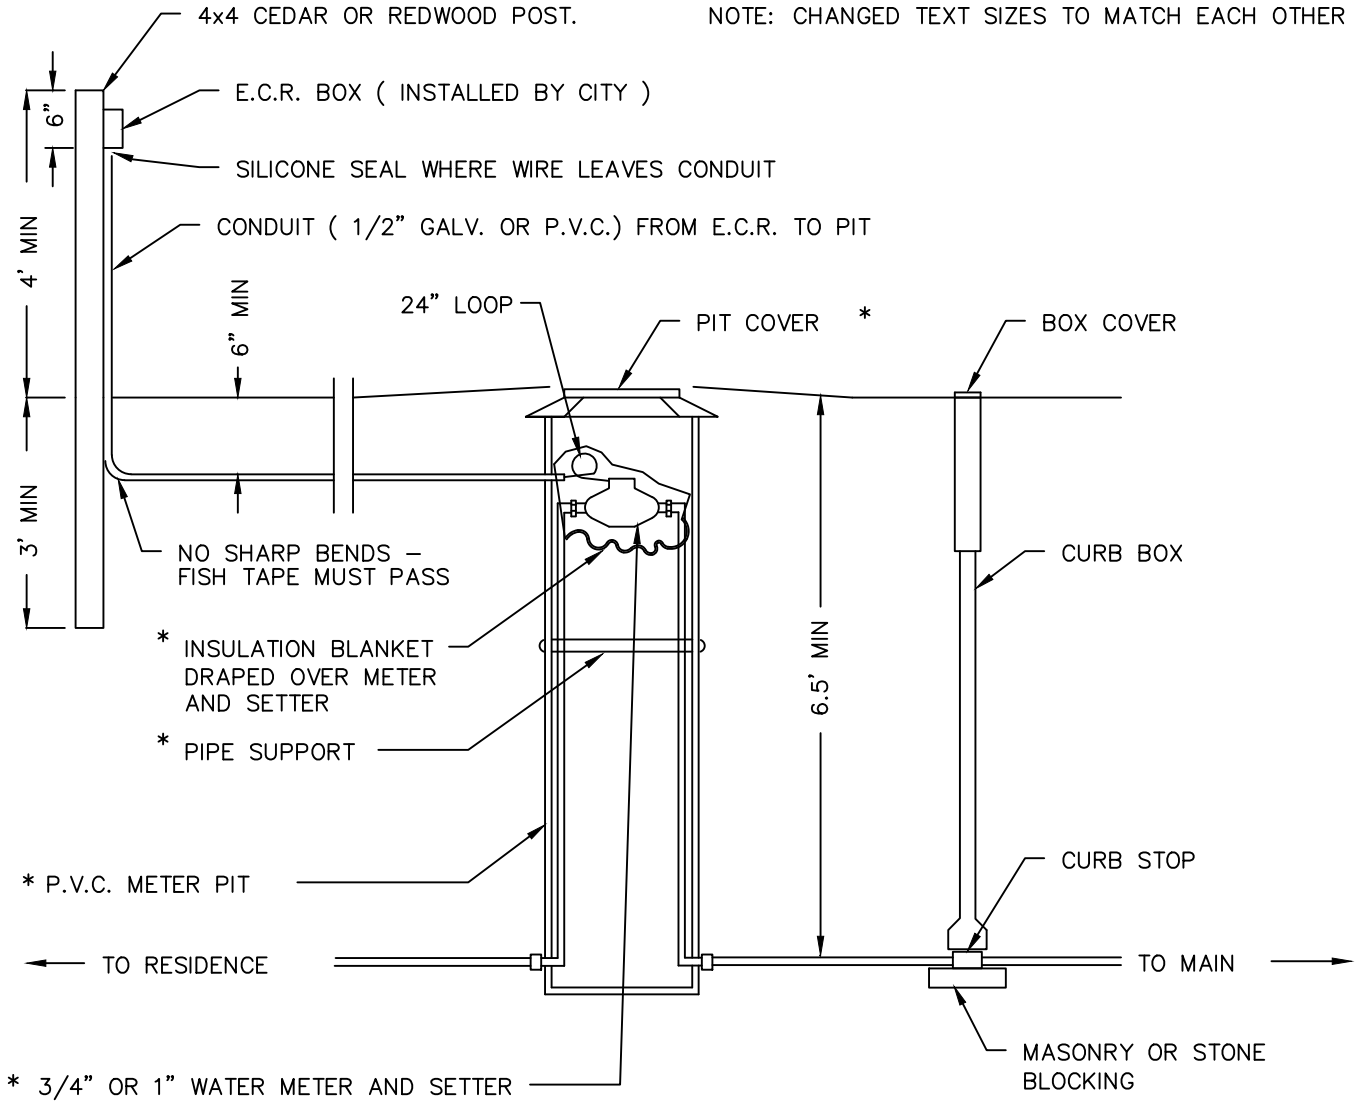

* = PARTS SUPPLIED BY CITY TO CONTRACTOR ON EXIST. USED SERVICE LINES

NOTE:

PLUMBER SHALL SEAL METER REGISTER WITH DOW-CORNING SILICONE SEALANT
 OR APPROVED EQUAL.

RESIDENTIAL WATER METER PIT